


Watlington Air Quality


NO₂ Monitor at Town Hall

The Town Hall monitor records the average NO₂ concentration for each hour throughout the day as an indication of the level of air pollution. The unverified results are shown below in comparison with the EC hourly and annual objectives for air quality. The monthly average was 36.0 µg/m³ and below the annual objective. The monthly average shows less of an increase than last year, possibly as a result of the extended periods of fine weather during September. The annual average to date (42.5) however remains above the objective. The hourly objective was not exceeded during September.

Watlington air quality - September 2014

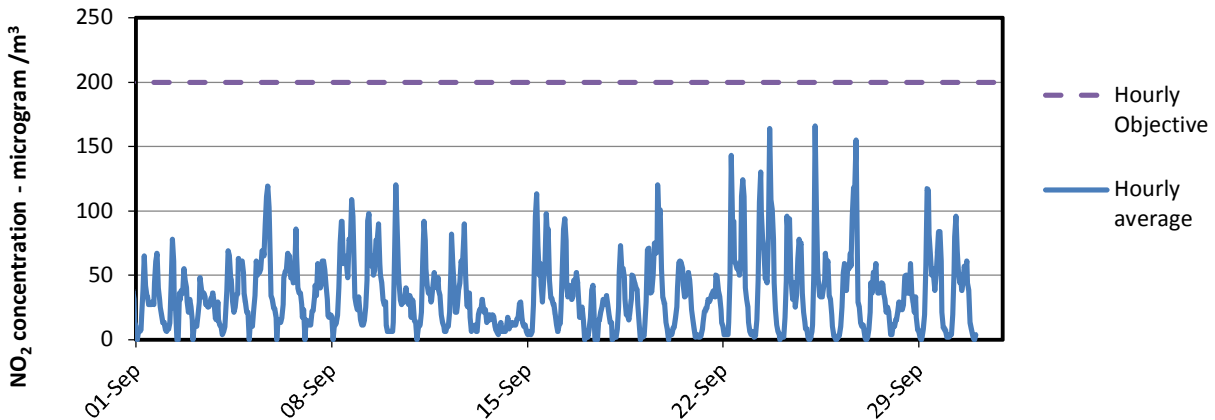

Watlington air quality - Monthly average

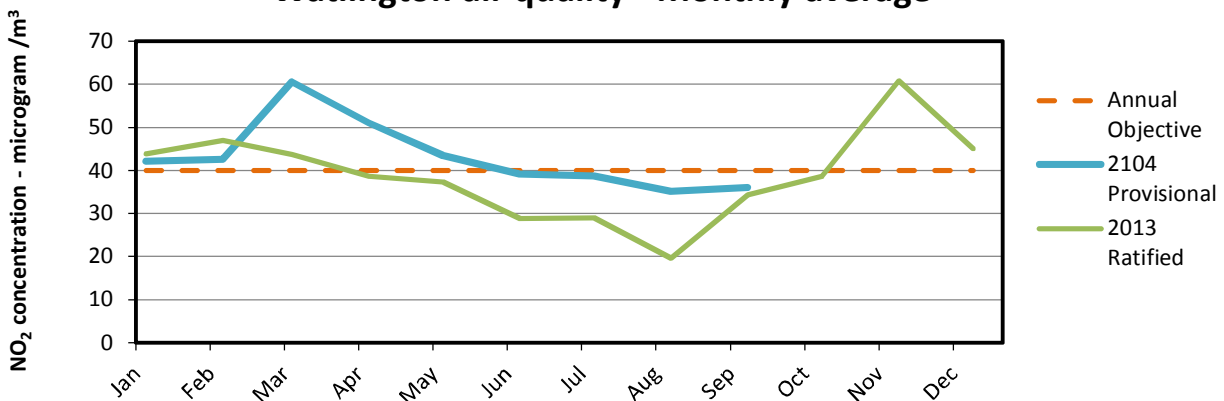

Annual air quality 2014

